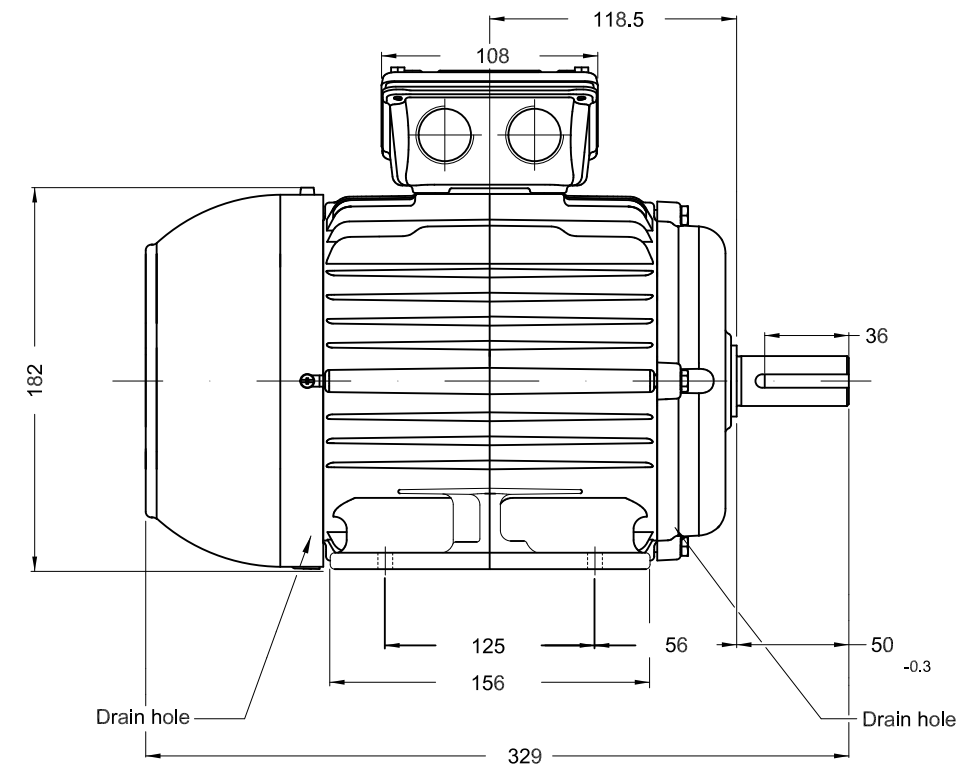


1.5 kW		04 Poles	50 Hz					A	
ECM	LOC	SUMMARY OF MODIFICATIONS				EXECUTED	CHECKED	RELEASED	
EXECUTED			THREE PHASE W22 MOTOR - PREMIUM EFF				PREVIEW 		
CHECKED			FRAME 90L IP55 TEFC						
RELEASED									
REL DT.		WMO	Jaragua do Sul	Product Engineering	SHEET	1 / 1			