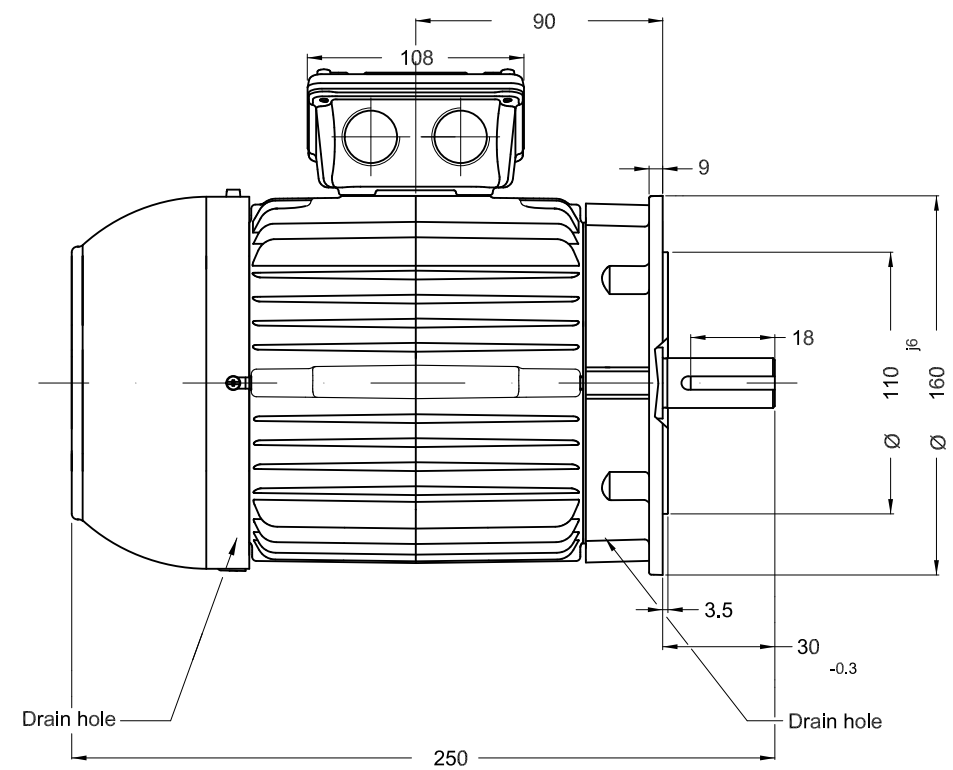


0.25 kW 04 Poles 50 Hz										A
ECM	LOC	SUMMARY OF MODIFICATIONS				EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED			THREE PHASE W22 MOTOR - PREMIUM EFF FRAME 71 IP55 TEFC				PREVIEW			
CHECKED										
RELEASED										
REL DT.		WMO	Jaragua do Sul	Product Engineering		SHEET	1 / 1			